




If outside temperature  $<60^{\circ}\text{F}$



Must maintain  $68^{\circ}\text{F}$  at a point 2' in from exterior walls and 3' above the floor in every habitable room.

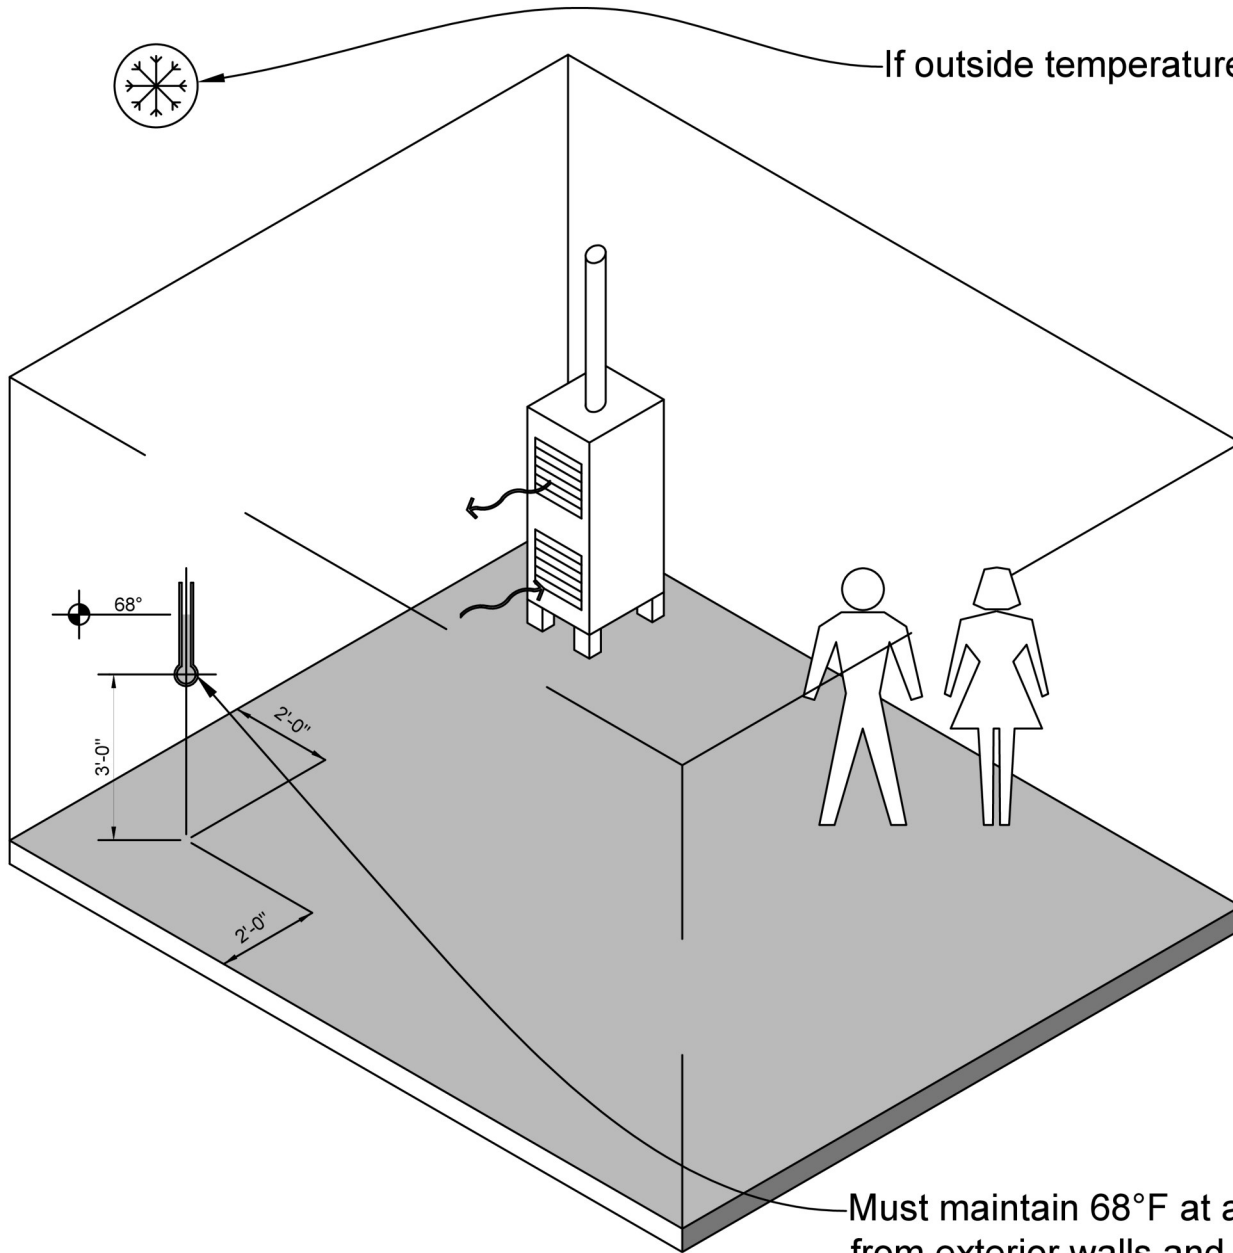